



Contents lists available at ScienceDirect

Ain Shams Engineering Journal

journal homepage: www.sciencedirect.com



Comparative analysis of optimal damped and undamped passive filters using MIDACO-solver

Nor Hidayah Abdul Kahar^{a,*}, Ahmed F. Zobaa^b, Rania A. Turkey^c, Ahmed M. Zobaa^d, Shady H.E. Abdel Aleem^e, Bazilah Ismail^a

^a Electrical Engineering Section, Universiti Kuala Lumpur British Malaysian Institute, 53100 Selangor, Malaysia

^b Department of Electronic and Electrical Engineering, Brunel University London, Uxbridge UB8 3PH, United Kingdom

^c Electrical Engineering Department, Faculty of Engineering and Technology, Future University in Egypt, Cairo 11835, Egypt

^d Electrical Power Engineering Department, Faculty of Engineering, Cairo University, Giza 12613, Egypt

^e Electrical Engineering Department, Valley High Institute of Engineering and Technology, Science Valley Academy, Qalyubia 44971, Egypt

ARTICLE INFO

Article history:

Received 6 October 2022

Revised 6 November 2022

Accepted 26 November 2022

Available online 08 December 2022

Keywords:

Harmonic analysis
Global optimisation
Resonance damping
Non-linear loads
Passive filter
Quality factor

ABSTRACT

Harmonic pollution is one of the challenging problems facing power networks recently due to the wide-spread non-linear loads and inverter-based renewables. In this regard, this work presents the optimal design of damped and undamped passive filters using a solver called Mixed-Integer Distributed Ant Colony Optimisation (MIDACO). This solver is employed to obtain an optimal design strategy for single-tuned passive power filters by investigating three primary criteria – minimisation of active power losses of the Thevenin's resistor, maximisation of the true power factor, and maximisation of the transmission efficiency. Several constrictions associated with the designed filters have been considered, in which the global maximum or minimum criterion was attained by retaining the quality factors of the designed filters within a particular range, damping harmonic resonance, achieving a permissible range of the power factor, limiting voltage harmonic distortion by complying with IEEE Std. 519–2014 restrictions. Besides, the performance limits of capacitors operating in distorted systems have been met while complying with IEEE Std. 18–2012. Further, the results obtained using the MIDACO solver in four different case studies are compared to those obtained using particle swarm optimisation and genetic algorithm. In addition, this work depicts the damping resistor of the inductance in the single-tuned filters. The benefits and drawbacks of damping over an undamped filter are discussed. Finally, the results validate the effectiveness of the MIDACO solver employed in this paper.

© 2022 THE AUTHORS. Published by Elsevier BV on behalf of Faculty of Engineering, Ain Shams University. This is an open access article under the CC BY-NC-ND license (<http://creativecommons.org/licenses/by-nc-nd/4.0/>).

1. Introduction

Recent years have witnessed an escalation in the application of non-linear loads for power systems that, unfortunately, led to different power quality issues. Some non-linear loads employed in industrial and commercial sectors include variable speed drives (VSDs), power converters, mixed inverter-based renewables [1,2],

computers, and light dimmers. For instance, harmonic pollution increases power loss in electrical appliances and causes communication disruption. Consequently, these power quality and system harmonics issues have emerged as rising concerns requiring harmonic management to sustain productivity and reliability in the industrial sector [3].

Several approaches have been investigated to address issues that occur in harmonics [4–6]. In this regard, passive power filters (PPFs) appear to be highly sought to mitigate harmonics, compared to other techniques, due to their non-complicated, robust, lower cost, and maintenance-free operation. Moreover, the PPF compensates reactive power to the system, improves the power factor, and minimises active power losses [7].

The performance exerted by PPF depends on two key factors: the circuit topology and the selection of the proper parameters. Therefore, designing a PPF seems challenging due to the uncertain

* Corresponding author.

E-mail addresses: norhidayahkahar@unikl.edu.my (N. Hidayah Abdul Kahar), a.m.zobaa@cu.edu.eg (A.M. Zobaa).

Peer review under responsibility of Ain Shams University.



Production and hosting by Elsevier

<https://doi.org/10.1016/j.asej.2022.102056>

2090-4479/© 2022 THE AUTHORS. Published by Elsevier BV on behalf of Faculty of Engineering, Ain Shams University.

This is an open access article under the CC BY-NC-ND license (<http://creativecommons.org/licenses/by-nc-nd/4.0/>).

Nomenclature

f_n, f	Tuned and fundamental frequency	I_{SK}, I_S	Rms source current at the k th harmonic (A)
k, k_n, k_r	Harmonic order, tuned harmonic order and harmonic order activating resonance	I_{LK}, I_L	Rms load current at the k th harmonic (A)
R_{LK}, X_{LK}	Load resistance and reactance at the k th harmonic (ohms)	I_{CK}, I_C	Rms capacitor current at the k th harmonic (A)
R_{THK}, X_{THK}	Thevenin resistance and reactance at harmonic order k (ohms)	P_S, P_L	Supply and load powers (W)
R, X_L, X_C	Resistance, inductive and capacitive reactances (ohms)	Q_C	Reactive power of capacitor (kVAR)
V_{THK}, V_{TH}	Thevenin rms voltage at the k th harmonic (V)	θ_K, ϕ_K	Angles of load voltage and line current (rad)
V_{LK}, V_{CK}	Load and capacitor voltage at the k th harmonic (V)	QF	Quality factor
V_L, V_C	Load and capacitor rms voltage (V)	PF, η	Power factor and transmission efficiency (%)
V_{CP}	Capacitor peak voltage (V)	P_{LOSS}	Power losses of the Thevenin resistor (W)
		$VTHD$	Voltage total harmonic distortion (%)
		n_{pop}, k and Ω	Ant, kernel and oracle parameters.

operating conditions requiring continuous measurements [8]. Accordingly, several methods have been presented in the literature to overcome these issues [9,10].

The single-tuned PPF used in [11] was designed to mitigate the harmonics generated by the AC-DC converter-based self-excited DC shunt motor. A comprehensive parametric analysis for the single-tuned PPF was carried out in [12]. In [13], the single-tuned PPF was used to mitigate the harmonic pollution in radial distribution networks using particle swarm optimisation (PSO). In [14] the authors compared different harmonic suppression solutions employed in traction systems and found that single-tuned PPF is the most economical and effective solution. In [15], the single-tuned PPF was used to mitigate harmonics in a large industrial plant while considering the voltage sag. The authors in [16] introduced a harmonic power flow analysis for power systems using MATPOWER, using four types of PPFs. Clearly, the single-tuned PPF is widely used in transmission and distribution networks, so the optimal design of such a filter is vital for power networks and in recent power quality published works.

Apart from the single-tuned type, PPF generally is widely used to suppress harmonics in power networks. Many research efforts have been exerted to obtain the optimal design of different PPF types. For instance, an optimal design for damped third-order PPF using a multi-objective Pareto-based firefly algorithm was presented in [17]. The authors in [10] have introduced a comparative analysis of double-tuned PPF design methods using a slime mould optimisation algorithm. In [18], a novel design of fourth-order PPF was demonstrated using a crow spiral-based search algorithm.

The complexity of PPF design increases with increasing the filter order, the number of objectives and the considered constraints. The single-tuned PPF has the advantage of its more straightforward design process over other PPF types, especially if there is one dominant harmonic whose elimination improves the system's performance significantly.

This study focuses on harmonics mitigation, whereby the parameter of a single tuned filter is optimised via mixed-integer distributed ant colony optimisation (MIDACO). In fact, the scavenging behaviour of artificial ants has inspired this method by extending the mixed-integer search domains. Although this tool is relatively new in PPFs design, this solver has displayed good efficiency for the investigated engineering problem [19]. Three main objectives are investigated: maximisation of power factor, minimisation of power loss of the Thevenin's resistor, and maximisation of the transmission efficiency. Moreover, the design satisfies specific performance criteria displayed by the filter, filter values to avoid resonances, power factor range to ascertain transmission

efficiency, and current and voltage individual harmonic values, following IEEE Std. 519-2014 [20]. Previously, a damped single-tuned filter has been proposed for harmonics elimination without considering the practical values of the capacitor [21].

Additionally, in this study, the manufacturer's standard values for the capacitor are considered, where the standard used is IEEE Std. 18-2012 [22]. These values are regarded as constraints, as the capacitor value should be one of the practical values in the market [23,24]. Further, a comparative study between the damped filter over the proposed undamped filter, presented in [25], is proposed in this work by depicting the damping resistor of the inductance in the single-tuned filters, whereby the benefits and drawbacks of damping over undamped filters are presented and discussed in four different case studies. Besides, the results obtained from MIDACO solver are analysed and compared with two milestone algorithms: genetic algorithm (GA) and PSO. Accordingly, the core contributions of this work can be summarized as follows:

- The optimal design of damped and undamped passive filters using MIDACO solver is presented.
- Due to the nonlinearity of the problem, three primary criteria are investigated – minimisation of active power losses of the Thevenin's resistor, maximisation of the true power factor, and maximisation of the transmission efficiency.
- Several constrictions associated with the designed filters have been considered, in which the global maximum or minimum criterion was attained.
- The practical performance limits of capacitors operating in distorted systems have been met while complying with IEEE Std. 18-2012.
- The results obtained using the MIDACO solver in four different case studies are compared to those obtained using PSO and GA.
- The benefits and drawbacks of damping over an undamped filter are discussed.
- Sensitivity analysis of the MIDACO solver has been discussed.
- The outcomes from the study displayed that the proposed approach attained better accuracy and more efficiency.

This paper is organised as follows – Section 2 describes the elementary design of single-tuned harmonic filters and their design considerations. Section 3 presents the system under study, and the optimisation problem is formulated in Section 4. Section 5 presents the MIDACO solver employed in this work. Section 6 presents the simulation results obtained and their discussions. Section 7 presents the conclusions drawn from the analysis and the possible future works.

2. Design of shunt-connected single-tuned filters

The filter possesses a non-intricate series RLC circuit configuration. The filter provides power loss from the resistor, R , commonly referred to as an intrinsic resistance to inductance. The incorporation of resistance is called 'damping' as it helps dampen resonance between the filter and the system.

2.1. Design equations

At a tuned frequency, f_n , the optimal filter can be obtained when harmonic inductive and capacitive reactance expressions are equal [26]; thus:

$$f_n = \frac{1}{2\pi\sqrt{LC}} \quad (1)$$

The tuned harmonic order k_n which can be formulated as [26]:

$$k_n = \frac{f_n}{f} = \sqrt{\frac{X_C}{X_L}} \quad (2)$$

where f denotes the fundamental frequency; X_L refers to the inductive reactance, $X_L = 2\pi fL$; and X_C reflects the capacitive reactance, $X_C = \frac{1}{2\pi fC}$. At the k th harmonic frequency, the total impedance can be written as [26]:

$$Z_F = R + j(kX_L - \frac{X_C}{k}) \quad (3)$$

The filter inductor quality factor, QF , is determined from the correlation between filter reactance and resistance. The value of the quality factor can be obtained from (4) as follows [26]:

$$QF = \frac{1}{R} \sqrt{\frac{L}{C}} \quad (4)$$

where R dictates the peak of the harmonic impedance.

The following are several notations pertaining to QF of a single-tuned filter: the QF value is not measured regularly to determine the filtering performance. This is because the resistance values employed to alter the filter's response may incur an increased loss. A higher QF value indicates a sharper peak for resonance and thus results in higher frequency selectivity and enhanced harmonic attenuation. Furthermore, higher QF minimises passband. The best practical values for QF should range between 20 and 100. Nevertheless, the responses cannot be differentiated clearly, except for the peak that indicates the harmonic resonance magnitude [26].

2.2. Design considerations

The primary drawback of integrating the single-tuned filter into a power circuit is that resonances may occur in a series or parallel and may cause amplification in the current and voltage, hence may damage the circuit. The issue associated with resonances happens due to filter detuning, whereby typical operations are due to temperature, RLC manufacturer's tolerance, capacitor fuse blowing, and system variants. Consequently, tuning the filter at a range of 3 % to 10 % away from the sought harmonic frequency is advisable to hinder these two resonances [26].

3. Studied system

Fig. 1 illustrates the harmonic circuit model employed in this study that comprised a bus with linear loads, variable-quality factor-based single-tuned passive filter, and non-linear loads.

The shunt-connected filter disallows the harmonic current source from passing through the source, whereby the filter impe-

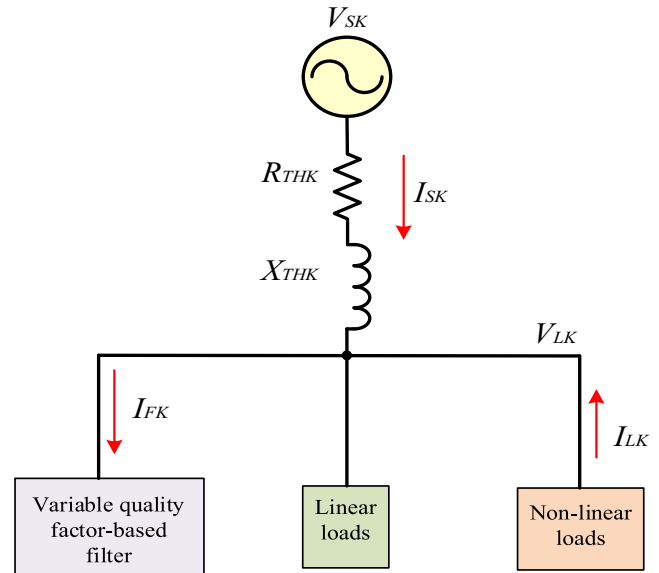


Fig. 1. Studied system.

dance limits the harmonic current. After different mathematical modelling equations, the load power factor, PF , could be described as [25]:

$$PF = \frac{P_L}{I_S V_L} = \frac{\sum V_{LK} I_{SK} \cos(\theta_k - \phi_k)}{\sqrt{\sum I_{SK}^2} \sqrt{\sum V_{LK}^2}} \quad (5)$$

where, P_L denotes load power; V_{LK} and I_{SK} denote the load voltage and source current at the k th harmonic order, respectively. In addition, V_L denotes rms load voltage; I_S denotes rms source current; θ_k denotes angle of V_{LK} ; and ϕ_k denotes angle of I_{SK} .

Apart from that, active power losses in the Thevenin's resistor, P_{Loss} , is described below to display the filter performance [25]:

$$P_{Loss} = \sum_K I_{SK}^2 R_{THK} \quad (6)$$

Additionally, the transmission efficiency is given as follows [25]:

$$\eta = \frac{P_L}{P_S} = \frac{\sum V_{LK} I_{SK} \cos(\theta_k - \phi_k)}{\sum V_{LK} I_{SK} \cos(\theta_k - \phi_k) + \sum I_{SK}^2 R_{THK}} \quad (7)$$

where P_S and R_{THK} are supply power and Thevenin's resistance at the k th harmonic, respectively. The voltage total harmonic distortion (VTHD) can be formulated as follows [20]:

$$VTHD = \frac{\sqrt{\sum_{K \geq 2} V_{LK}^2}}{V_{L1}} \quad (8)$$

The above indices are used to assess the filter's performance using different optimisation techniques with and without resistance that can dampen the harmonic resonance, as shown in the results section.

4. Optimisation problem

Constraint of standard value of capacitor: By adhering to IEEE Std. 18–2012, this study had set the values of manufactured capacitors in voltage and reactive power as nominal current, I_C , was less than 135 %, rated capacitor voltage, V_C , was less than 110 %, rated peak voltage, V_{CP} , was less than 120 %, and reactive power and Q_C was less than 135 % [22–24].

Constraint of QF: The QF for the tuning reactor was set between 20 and 100 for this problem [26].

Constraint of harmonic resonance: The occurrence of resonance in series and parallel occurred when $X_L = X_C$. Therefore, the harmonic order that activated resonance, k_r , is defined in (8), where X_{TH1} was the Thevenin reactance at the fundamental frequency [26].

$$h_r = \sqrt{\frac{X_C}{X_L + X_{TH1}}} \quad (8)$$

The circuit has the least impedance and exciting voltage in the case of the series resonance, but it could produce a high current. Contrarily, parallel resonance possesses impedance at its maximum and a small, exciting resonance current with amplified voltage. Therefore, avoiding both types of resonances is crucial through incorporating k_n constraint in (2), which should exceed k_r in (8). Furthermore, the k_n value should be tuned to 9 % from the harmonic frequency to hinder these resonances.

Constraint of VTHD: The IEEE Std.-519 recommends that maximum values for VTHD should be at 5 % or lower [20].

Constraint of PF: A penalty is present when PF dips to less than 90 % in certain appliances to ascertain efficiency of electricity usage. Therefore, a PF load equivalent to or higher than 90 % was weighed upon designing the filter.

Then, the problem formulation of the objective functions and constraints is listed as follows:

$$\text{Criterion 1} = P_{Loss}(R, X_C, X_L) \quad (9)$$

$$\text{Criterion 2} = PF(R, X_C, X_L) \quad (10)$$

$$\text{Criterion 3} = \eta(R, X_C, X_L) \quad (11)$$

where $k_r < k \leq 0.9f_n$, $20 \leq QF \leq 100$, $VTHD \leq 5\%$, $PF \geq 90\%$ and capacitor following IEEE Std. 18-2012.

5. Optimisation algorithm

A method that integrates the C solver, known as the MIDACO solver, has been incorporated as a tool for optimisation to address the problem formulation depicted in (9)–(11). This solver is considered an innovative optimisation solver that merges the extended ant colony optimisation (ACO), which is of the evolutionary meta-heuristics class, and the oracle penalty method to control constrictions [27]. The concept of ACO was initiated by Marco Dorigo [28], whereby mimicking the biological traits of ants appeared to be the fundamental notion. Initially, biological ants find food (F) by rummaging around their nest. Upon discovering F, a pheromone marks the trail upon returning to the nest (N) to attract other ants to locate the food source. As the old trail wafts away, new trails are continuously tinged with pheromones.

Consequently, the distance between the nest and the food source gets shorter as the trail is updated. The extended ACO meta-heuristic is embedded in MIDACO solver, whereby the algorithm reflects the approximation method of stochastic Gauss. Furthermore, its approach is dictated by the 'pheromone-controlled probability functions' (PDFs) for distinct domains rather than applying the pheromone table that portrays the benefits of ACO [29]. Although the method of penalty appears non-intricate, it is challenging to obtain the desired performance. Therefore, MIDACO solver initiates a novel idea of a typical penalty, known as the 'oracle penalty method', to control constrictions [28]. This approach overcomes an issue by altering an oracle (Ω) parameter to gain better or equivalent global solutions.

Moreover, the key benefit of MIDACO solver, which resembles a black box, is that it offers its users the freedom to determine objec-

tive functions and constrictions that may appear in various forms. Additionally, this software program provides an optimal solution that is the global maximum/minimum without the need to exam-

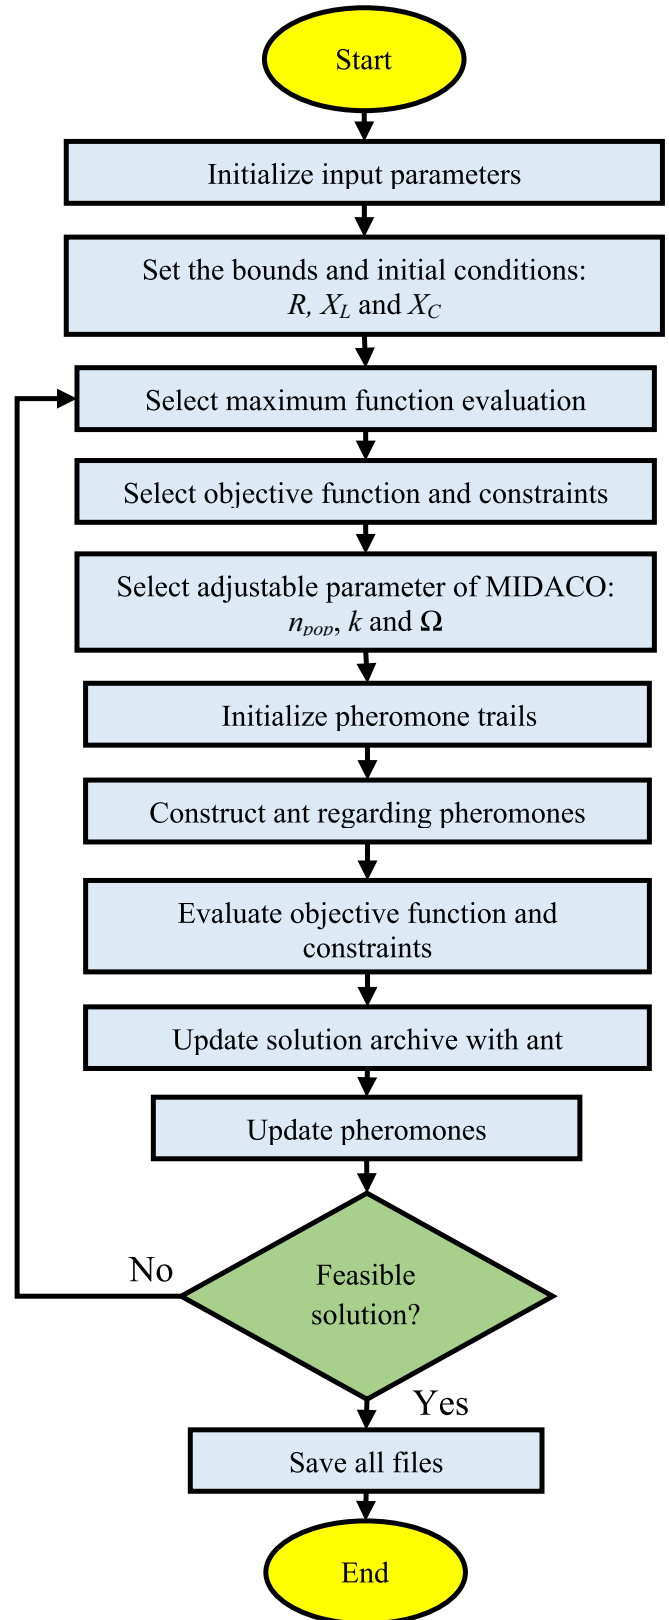


Fig. 2. The flowchart of ACO.

ine varied values in its primary settings. The flow chart of the ACO is shown in Fig. 2.

Many researchers have recently used the ACO to solve many engineering problems; for example: In [30], the ACO was used to develop enhanced torque control of switched reluctance motor drives. A cloud control system for unmanned aerial vehicles based on ACO was presented in [31]. An optimal design of gravitational sewer networks using ACO was introduced in [32]. As seen, the full potential of ACO and MIDACO is not yet exploited in electric power research, which is one of the main contributions of this research.

6. Simulation results and discussion

6.1. Results of damped single-tuned passive filter

A total of four various utility cases were simulated after the filter was designed. As such, this study set all the constant values, as shown in Table 1. The information on the studied system was retrieved from IEEE Std. 519-1992 [15], whereby all the cases employed were selected from previous publications. These included the 3-phase load power = 5100 kW, 3-phase load reactive power = 4965 kVAR, line-to-line supply voltage = 4160 V, load resistance = 1.742 Ω and load reactance = 1.696 Ω. Besides, the load current has been set to 33 A, 25 A, 8 A and 9 A at the 5th, 7th, 11th and 13th harmonics for all cases.

Table 2 presents prior and post effects, incorporating the designed filters into the method that has been proposed to determine the performance of the system. Several parameters employed to control the MIDACO solver have been set as follows: MIDACO solver dynamically adjusted n_{pop} per generation, while the maximum k was fixed at 100, and $\Omega = 0$.

Additionally, Table 2 shows the obtained results, whereby optimal filter was attained with varying optimum solutions upon improvised power factor, minimised loss in the Thevenin's resistor and maximised efficiency. Besides, the proposed filter displayed satisfactory results with improved performance upon R , X_L , and X_C additions.

Furthermore, the decreased short-circuit capacity increased Thevenin's impedance. Such outcomes appeared to increase the active power losses and thus reduced the efficiency of transmission. Nevertheless, an increment was noted in the system's power factor primarily due to lower harmonic current. Case 1 and Case 3 exhibited the findings obtained for the varied capacities of short circuits with similar harmonics settings.

On the contrary, similar values of Thevenin's impedance exhibited decreased power factor with added harmonics voltage in the system. Such findings appeared to increase the line current that passed through the power source. When the line current was higher, the loss in Thevenin's resistor increased, and a drop in voltages was noted, indicating a slump in the efficiency of the trans-

mission. Case 1 and Case 2 presented a similar capacity for a short circuit with varied settings for harmonics voltage.

Besides, the restrictions that limit the primary capacitors based on the practical standard were calculated, whereby the results for V_{CP} , V_C , I_C , and Q_C were in the range of 66.02 % to 69.70 %, 89.21 % to 90.63 %, 95.29 % to 101.64 %, and 84.03 % to 88.14 %, respectively. The results showed that all the capacitors embedded in the system were functioning well, following the IEEE standard.

Fig. 3 depicts the filter's impedance in the resonant circuit and the impact peak for resonance for different QF values used based on the three criteria for Case 1, where h denotes a generalised harmonic order. Integrating single-tuned filters into the system led to series and parallel resonances. The capacitance and inductance reactance values were equal in the series resonance, thus making resistance hit the local minimum at resonant.

On the other hand, the resistance was at its local maximum for parallel resonance, whereby the R value determined the resonant peak. The lower the R value, the higher the QF value, and the sharper the resonant peak, resulting in high-frequency selectivity. Nevertheless, a reduction was noted in the passband with a higher QF . It should be tuned to below the filtered harmonic to prevent any damage caused by the harmonic resonance.

6.2. Sensitivity of the MIDACO solver results

The sensitivity analysis of the MIDACO solver is shown in Table 3 for all cases, where two parameters are implemented in the proposed algorithm – ants (n_{pop}) and kernels ($kernel$). Fig. 4 (a) shows the optimal solutions obtained with different values of the oracle parameter. Besides, Fig. 4(b) shows the optimal solutions obtained by increasing the number of function evaluations. These figures validate the effectiveness of MIDACO solver in getting the global solution to the investigated problem.

6.3. Comparison with other techniques

This study presents the viability of the proposed approach by comparing its performance with two well-known optimisers, the GA and the PSO. Table 4 shows the comparison outcomes of MIDACO solver with GA and PSO. For the GA, the simulation was done using population size, crossover rate, and mutation probability, which were set to 50, 0.8, and 0.001, respectively. Furthermore, Table 4 presents the simulated results when PSO was simulated with its learning factors; cognitive and social attractions were set to 1.0 and 1.5, respectively. Besides, the velocity was controlled, while the weight of inertia was reduced from 0.9 to 0.5 linearly at iterations, and both population size and maximum iteration were set at 50 and 200, respectively. From Table 4, the results show that MIDACO solver provides better accuracy than GA and PSO, in which the outcomes of $VTHD$ seemed to not only satisfy the constraints, however, also appeared lower than the standard limit.

Table 1
Studied system.

Parameters	Cases			
	1	2	3	4
Short circuit, MVA	150	150	80	80
R_{TH1} (Ω)	0.01154	0.01154	0.02163	0.02163
X_{TH1} (Ω)	0.1154	0.1154	0.2163	0.2163
V_{S1} (kV)	2.4	2.4	2.4	2.4
V_{S5} (%)	5	7	5	7
V_{S7} (%)	3	4	3	4
V_{S11} (%)	2	2	2	2
V_{S13} (%)	1	1	1	1

Table 2
Results obtained with and without the filter connection.

Settings	X_C (Ω)	R (Ω)	X_L (Ω)	PF (%)	η (%)	P_{Loss} (kW)	VTHD (%)
Case 1							
No filter	–			71.72	99.34	10.48	6.20
Criterion 1	4.43	0.011	0.217	96.24	99.63	6.15	2.48
Criterion 2	4.30	0.040	0.210	96.56	99.63	6.20	2.43
Criterion 3	4.43	0.013	0.218	96.25	99.63	6.16	2.48
Case 2							
No filter	–			71.71	99.34	10.48	8.22
Criterion 1	4.30	0.025	0.211	94.43	99.62	6.45	3.04
Criterion 2	4.43	0.029	0.219	94.27	99.62	6.47	3.13
Criterion 3	4.18	0.009	0.205	94.57	99.62	6.40	2.98
Case 3							
No filter	–			71.71	98.78	18.45	6.38
Criterion 1	4.57	0.010	0.227	97.33	99.33	11.02	1.91
Criterion 2	4.30	0.048	0.212	98.11	99.34	11.09	1.85
Criterion 3	4.57	0.013	0.210	97.26	99.33	11.05	1.82
Case 4							
No filter	–			71.71	98.78	18.45	8.29
Criterion 1	4.71	0.011	0.231	96.05	99.31	11.29	2.31
Criterion 2	4.30	0.043	0.212	97.27	99.32	11.27	2.21
Criterion 3	3.95	0.016	0.191	97.85	99.34	11.12	2.00

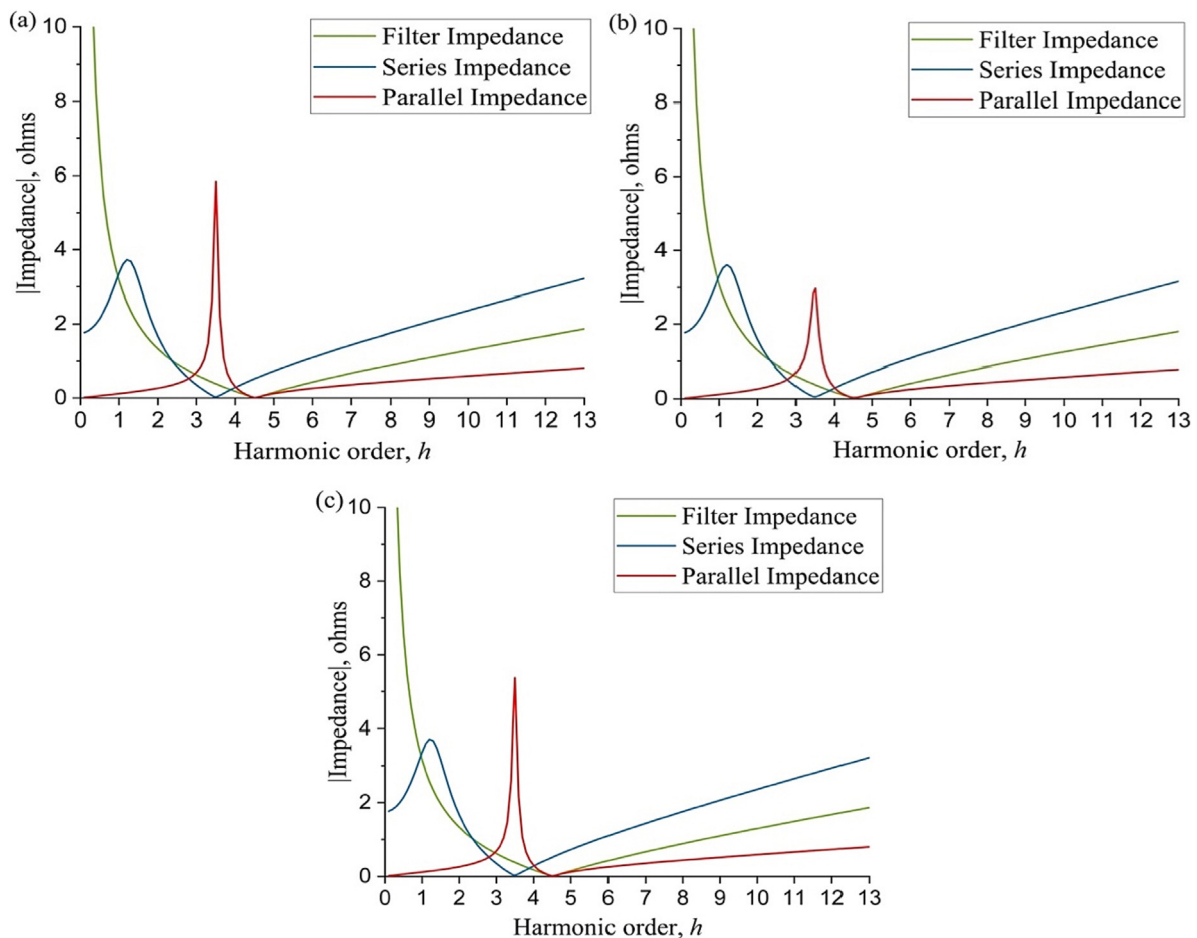


Fig. 3. Impedance resonance for case 1: (a) minimise P_{Loss} , (b) maximise PF and (c) maximise η .

Furthermore, Table 4 exhibited that both GA and PSO provided extremely high VTHD for all cases.

Meanwhile, Table 5 presents the outcomes of statistical analysis for all the methods examined at their best run following the limits set in Criterion 2. The results showed that the proposed technique displayed a higher chance of achieving optimal global solutions upon reaching the maximum function evaluation.

6.4. Comparison of the damped and undamped filters

To further comprehend the impact of the damping resistor on the system, a comparative study between the proposed damped filter in this research and the proposed undamped single-tuned filter [25] is presented. Table 6 shows the simulated results of damped

Table 3
Sensitivity of the optimiser for all cases investigated.

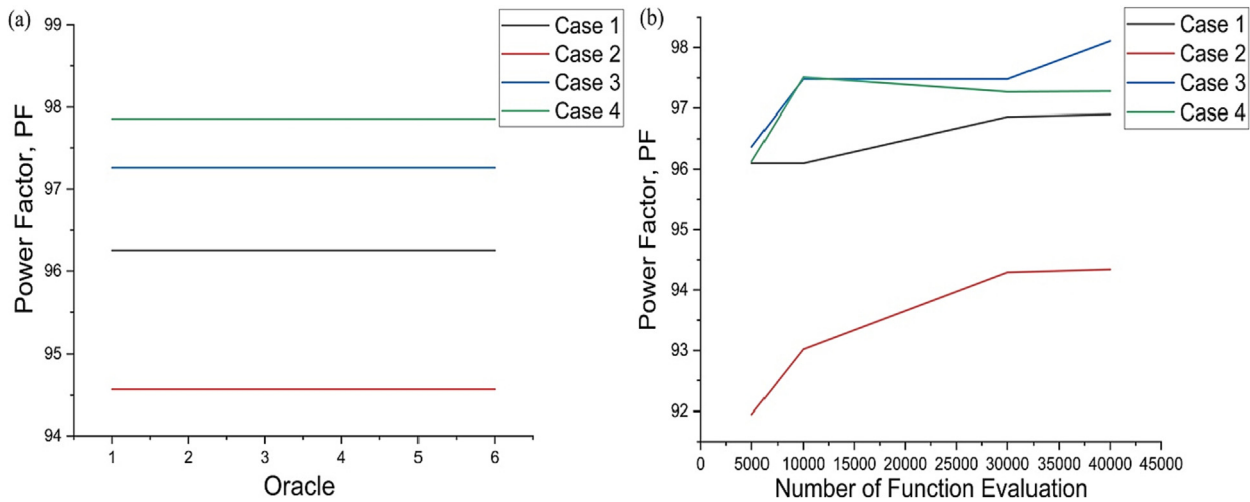
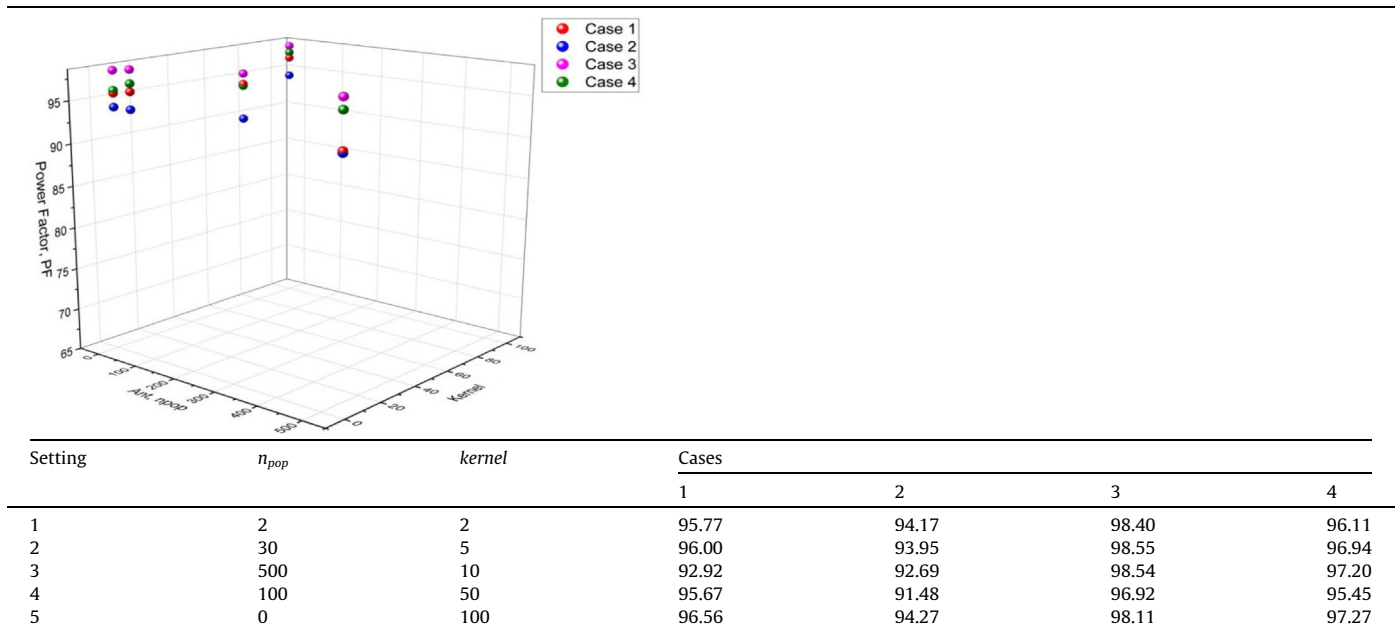


Fig. 4. Optimal solutions: (a) with different values of oracle parameter and (b) increasing number of function evaluation.

and undamped filters [25] for case 1 based on Criterion 2, which is to maximise PF.

The results presented in Table 6 validated that integrating an additional R resistor in the filter circuit increased power loss in the filter, thus deteriorating the system's performance. The findings also represented that reduction in PF led to an increment in the loss of Thevenin's resistor, which decreased the transmission efficiency and increased the $VTHD$ values. Moreover, Table 6 shows that k seems nearer to the fifth harmonics, suggesting that the dampened filter demands more ratings for reactor current and capacitor voltage, which could end in a higher filter cost.

Additionally, Fig. 5 shows that resonance frequency is unaffected by resistance. However, the same cannot be said for the circuit's bandwidth.

The damping effect of the resistor in the parallel resonance circuit widened the band, consequently making it less adequate for a damped filter. Nonetheless, the benefit of a damped filter refers to an increment in load power consumption for the system. This is

mainly due to the limited harmonic current supplied into the system and in the filter, whereby the reactor seems to limit the flow of harmonic current to the filter. Furthermore, a comparative study was performed between undamped and damped filters to determine the benefits and shortcomings of these filters. This was because the damping resistor should not be ignored, especially when designing a damped passive filter that can help damp harmonic resonance.

7. Conclusions and future works

The harmonics problem caused by non-linear loads can significantly impact electrical distributions and facilities they feed, decreasing the reliability of the power system. Therefore, to prevent the harmonics problem, it is critical to understand the causes, potential effects, and mitigation techniques during the design stage. Passive filter design is the most common type of method to solve this problem due to the design, which is simple and inex-

Table 4
Simulated results of MIDACO solver, GA and PSO.

Simulated results	MIDACO			GA			PSO		
	No. of Criteria								
	1	2	3	1	2	3	1	2	3
Case 1									
PF (%)	96.24	96.56	96.25	99.01	97.11	99.03	99.48	99.01	93.07
η (%)	99.63	99.63	99.63	99.65	99.64	99.65	99.66	99.65	99.60
P_{Loss} (kW)	6.15	6.20	6.16	5.88	6.36	5.88	5.88	6.01	6.98
VTHD (%)	2.48	2.43	2.48	4.12	4.88	3.94	4.34	4.80	4.91
Case 2									
PF (%)	94.43	94.27	94.57	99.24	97.62	99.02	98.85	97.23	99.23
η (%)	99.62	99.62	99.62	99.65	99.64	99.65	99.65	99.64	99.65
P_{Loss} (kW)	6.45	6.47	6.40	5.94	6.24	5.93	6.00	6.31	5.96
VTHD (%)	3.04	3.13	2.98	6.16	6.40	5.77	6.03	6.57	6.51
Case 3									
PF (%)	97.33	98.11	97.26	98.96	99.50	96.01	97.45	98.88	93.09
η (%)	99.33	99.34	99.33	99.35	99.35	99.30	99.33	99.35	99.26
P_{Loss} (kW)	11.02	11.09	11.05	10.82	11.08	12.37	11.83	11.32	13.29
VTHD (%)	1.91	1.85	1.82	3.18	4.11	4.35	4.39	4.32	4.32
Case 4									
PF (%)	96.05	97.27	97.85	99.17	96.99	97.01	98.99	97.70	98.58
η (%)	99.31	99.32	99.34	99.35	99.32	99.32	99.35	99.33	99.34
P_{Loss} (kW)	11.29	11.27	11.12	10.87	12.02	12.01	10.87	11.74	11.41
VTHD (%)	2.31	2.21	2.00	4.62	5.56	5.55	4.70	5.79	5.67

Table 5
Statistical measurement: Criterion 2.

Methods	Minimum value	Maximum value	Mean value	Standard deviation
Case 1				
MIDACO	95.7194	98.9827	96.5561	0.8101
GA	99.6827	99.7239	99.7117	0.0148
PSO	99.2157	99.2164	99.2162	0.0001
Case 2				
MIDACO	93.1374	98.0948	94.4083	1.0702
GA	99.3513	99.4848	99.4612	0.0442
PSO	98.2808	98.7809	98.7809	0.0001
Case 3				
MIDACO	97.5244	99.0366	98.3795	0.6781
GA	99.4642	99.8360	99.7594	0.1485
PSO	99.6648	99.6650	99.6649	0.0001
Case 4				
MIDACO	95.4917	98.1436	97.8629	0.5700
GA	99.3924	99.6656	99.5970	0.1364
PSO	99.3656	99.4423	99.4384	0.0111

Table 6
Comparison results of damped and undamped filter [25].

Filter	X_C (Ω)	R (Ω)	X_L (Ω)	PF (%)	η (%)	P_{Loss} (kW)	VTHD (%)	k	k_r
Damped	4.30	0.040	0.210	96.56	99.63	6.20	2.43	4.53	3.64
Undamped	3.95	-	0.195	97.18	99.64	6.05	2.35	4.50	3.57

pensive. A proposed mathematical modelling technique via MIDACO solver was presented in this paper to determine the optimal passive filter to minimise the harmonics while complying with practical standards. As such, a damping resistor of the single-tuned filter was weighed in, whereby the benefits and glitches of the damping filter over the undamped filter were identified.

Moreover, the key pros and cons of damping over an undamped filter were also presented in this paper. A total of four case studies

were carried out to compare this proposed technique with GA and PSO. The outcomes from the study displayed that the proposed approach recorded better accuracy and more efficiency, as the simulation findings exhibited that global maximum and minimum could be attained to satisfy all constraints set and functions outlined. Furthermore, this study demonstrated the competency of fast convergence for the proposed technique towards obtaining the best solution to the issues highlighted. Future works will pay

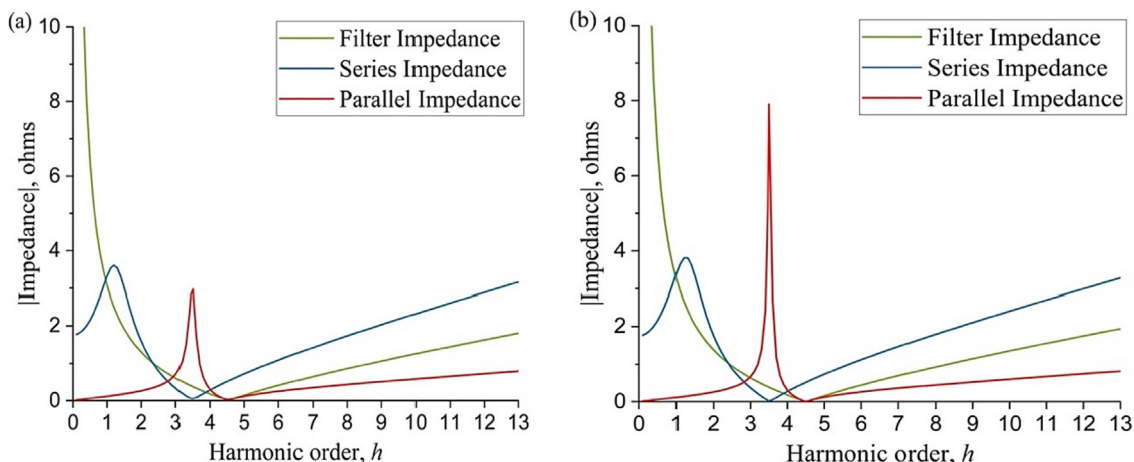


Fig. 5. Comparison of impedances resonance between (a) damped and (b) undamped filter [25] based on Criterion 2: Case 1.

attention to employing MIDACO solver in designing damped filters for mixed inverter-based renewable energy sources to optimize their performance while managing harmonics distortion.

Funding: The authors did not receive support from any organisation for the submitted work.

Declaration of Competing Interest

The authors declare that they have no known competing financial interests or personal relationships that could have appeared to influence the work reported in this paper.

References

[1] Rozlan MBM, Zobaa AF, Aleem SHEA. The optimisation of stand-alone hybrid renewable energy systems using HOMER. *Int Rev Electr Eng* 2011;6:1802–10.

[2] Ahmed EM, Rakočević S, Čalasan M, Ali ZM, Hasanien HM, Turky RA, et al. BONMIN solver-based coordination of distributed FACTS compensators and distributed generation units in modern distribution networks. *Ain Shams Eng J* 2022;13:101664.

[3] Singh GK. Power system harmonics research: A survey. *Eur T Electr Power* 2009;19. doi: <https://doi.org/10.1002/etep.201>.

[4] Liang C, Xu J, Luo L, Li Y, Qi Q, Gao P, et al. Harmonic elimination using parallel delta-connected filtering windings for converter transformers in HVDC systems. *IEEE Trans Power Delivery* 2017;32:933–41. doi: <https://doi.org/10.1109/TPWRD.2016.2580378>.

[5] Kumar AN, Raglend JJ. Multi-objective Control of Multi-Operational Grid-Integrated Inverter for PV Integration and Power Quality Service. *Ain Shams Eng J* 2021;12. doi: <https://doi.org/10.1016/j.asej.2021.01.036>.

[6] Bekakra Y, Zelloouma L, Malik O. Improved predictive direct power control of shunt active power filter using GWO and ALO – Simulation and experimental study. *Ain Shams Engineering Journal* 2021;12. <https://doi.org/10.1016/j.asej.2021.04.028>.

[7] Kumar N, Kumar A. Assessment of non-sinusoidal reactive power of shunt capacitors in the presence of distorted substation voltage in radial distribution systems. *Ain Shams Engineering Journal* 2018;9. <https://doi.org/10.1016/j.asej.2017.10.006>.

[8] Wang J, Zhang M, Li S, Zhou T, Du H. Passive filter design with considering characteristic harmonics and harmonic resonance of electrified railway. *Proceedings of 2017 8th International Conference on Mechanical and Intelligent Manufacturing Technologies, ICMIMT 2017*, 2017, p. 174–8. <https://doi.org/10.1109/ICMIMT.2017.7917458>.

[9] Mohammadi M, Rozbahani AM, Montazeri M. Multi criteria simultaneous planning of passive filters and distributed generation simultaneously in distribution system considering nonlinear loads with adaptive bacterial foraging optimization approach. *Int J Electr Power Energy Syst* 2016;79:253–62. doi: <https://doi.org/10.1016/j.ijepes.2016.01.013>.

[10] Zobaa AM, Abdel Aleem SHE, Youssef HKM. Comparative Analysis of Double-Tuned Harmonic Passive Filter Design Methodologies Using Slime Mould Optimization Algorithm. *2021 IEEE Texas Power and Energy Conference (TPEC)*, IEEE; 2021, p. 1–6. <https://doi.org/10.1109/TPEC51183.2021.9384950>.

[11] Hoque MR, Islam R, Islam K, Alam MJ. Performance Analysis of AC-DC Converter Based Self Excited DC Shunt Motor Using Single Tuned Passive Filter. In: *2018 10th International Conference on Electrical and Computer Engineering (ICECE)*, IEEE. p. 325–8. doi: <https://doi.org/10.1109/ICECE.2018.8636806>.

[12] Abbas AS, Ali ES, El-Sehiemy RA, El-Ela AAA, Comprehensive FKM, Analysis P, et al. 21st International Middle East Power Systems Conference (MEPCON). IEEE 2019;2019:465–72. doi: <https://doi.org/10.1109/MEPCON47431.2019.9007928>.

[13] Dzar Faraby M, Fitriati A, Christiono U, Muchtar A, Nur PA, Planning STF, et al. 3rd International Seminar on Research of Information Technology and Intelligent Systems (ISRITI). IEEE 2020;2020:418–22. doi: <https://doi.org/10.1109/ISRITI51436.2020.9315518>.

[14] Ko W, Tuomainen M. Design and application of a single-tuned passive harmonic filter to suppress harmonic distortion and resonance for railway traction power systems—A case study. *IET Electr Syst Transp* 2022;12:153–64. doi: <https://doi.org/10.1049/els2.12041>.

[15] Shakeri S, Esmaeili S, Rezaeian MH. Passive Harmonic Filter Design Considering Voltage Sag Performance - Applicable to Large Industries. *IEEE Trans Power Delivery* 2022;37:1714–22. doi: <https://doi.org/10.1109/TPWRD.2021.3096461>.

[16] Yang N-C, Adinda EW. Matpower-Based Harmonic Power Flow Analysis for Power Systems With Passive Power Filters. *IEEE Access* 2021;9:167322–31. doi: <https://doi.org/10.1109/ACCESS.2021.3135496>.

[17] Bajaj M, Sharma NK, Pushkarna M, Malik H, Alotaibi MA, Almutairi A. Optimal Design of Passive Power Filter Using Multi-Objective Pareto-Based Firefly Algorithm and Analysis Under Background and Load-Side's Nonlinearity. *IEEE Access* 2021;9:22724–44. doi: <https://doi.org/10.1109/ACCESS.2021.3055774>.

[18] Khattab NM, Abdel Aleem SHE, El'Gharably A, Boghdady TA, Turky RA, Ali ZM, et al. A novel design of fourth-order harmonic passive filters for total demand distortion minimization using crow spiral-based search algorithm. *Ain Shams Engineering Journal* 2022;13:101632. <https://doi.org/10.1016/j.asej.2021.11.001>.

[19] Teichgraeber H, Brodrick PG, Brandt AR. Optimal design and operations of a flexible oxyfuel natural gas plant. *Energy* 2017;141:506–18. doi: <https://doi.org/10.1016/j.energy.2017.09.087>.

[20] IEEE Power and Energy Society. *IEEE recommended practice and requirements for harmonic control in electric power systems*. IEEE Std 2014;519–2014 (2014):1–29.

[21] Kahar NHBA, Zobaa AF. Optimal single tuned damped filter for mitigating harmonics using MIDACO. In: *Conference Proceedings - 2017 17th IEEE International Conference on Environment and Electrical Engineering and 2017 1st IEEE Industrial and Commercial Power Systems Europe, EEEIC / I and CPS Europe*. doi: <https://doi.org/10.1109/EEEIC.2017.7977541>.

[22] *Std IEEE. IEEE standard for shunt power capacitors 18–2012*. vol. 012:2013.

[23] HE Abdel Aleem S, T Elmathana M, F Zobaa A. Different design approaches of shunt passive harmonic filters based on IEEE Std. 519-1992 and IEEE Std. 18-2002. *Recent Patents on Electrical & Electronic Engineering (Formerly Recent Patents on Electrical Engineering)* 2013;6:68–75.

[24] Zobaa AF, Abdel Aziz MM, Abdel Aleem SHE. Comparison of Shunt-passive and Series-passive Filters for DC Drive Loads. *Electr Power Compon Syst* 2010;38:275–91. doi: <https://doi.org/10.1080/15325000903273262>.

[25] Abdul Kahar NHB, Zobaa AF. Application of mixed integer distributed ant colony optimization to the design of undamped single-tuned passive filters based harmonics mitigation. *Swarm. Evol Comput* 2019;44. doi: <https://doi.org/10.1016/j.swevo.2018.03.004>.

[26] Das JC. Passive filters - Potentialities and limitations. *IEEE Trans Ind Appl* 2004;40. doi: <https://doi.org/10.1109/TIA.2003.821666>.

[27] Schlüter M, Gerdtts M. The oracle penalty method. *Journal of Global Optimization* 2010;47. <https://doi.org/10.1007/s10898-009-9477-0>.

[28] Dorigo M, Blum C. Ant colony optimization theory: A survey. *Theor Comput Sci* 2005;344. doi: <https://doi.org/10.1016/j.tcs.2005.05.020>.

[29] Schlüter M, Egea JA, Banga JR. Extended ant colony optimization for non-convex mixed integer nonlinear programming. *Comput Oper Res* 2009;36. doi: <https://doi.org/10.1016/j.cor.2008.08.015>.

- [30] Al-Amyal F, Számel L, Hamouda M. An enhanced direct instantaneous torque control of switched reluctance motor drives using ant colony optimization. *Ain Shams Engineering Journal* 2022;101967. <https://doi.org/10.1016/j.asej.2022.101967>.
- [31] Zhang L, Zhang R. Research on UAV cloud control system based on ant colony algorithm. *J Syst Eng Electron* 2022;33:805–11. <https://doi.org/10.23919/JSEE.2022.000080>.
- [32] Moeini R, Afshar MH. Arc Based Ant Colony Optimization Algorithm for optimal design of gravitational sewer networks. *Ain Shams Eng J* 2017;8:207–23. doi: <https://doi.org/10.1016/j.asej.2016.03.003>.



Ahmed M. Zobaa graduated from Faculty of Engineering (Electric Power and Machines Department), Cairo University (B.Sc.) with honors, in 2013. He received M.Sc. from the same department in Electrical Power Engineering in 2018. He is now pursuing his Ph.D. in Electrical Power Engineering, Faculty of Engineering, Cairo University. He was a Teaching Assistant in Cairo University from Jan. 2014 till Nov. 2018, and he is currently an Assistant Lecturer there. His research interests include power systems harmonics, power quality, and renewable energy.



Nor Hidayah Abdul Kahar received her Ph.D degrees in Electrical Engineering and Electronics Research from Brunel University London in 2020, M.Sc. degree (Hons.) in Electrical Power from the University of Newcastle, United Kingdom in 2013 and Bachelor of Eng. Technology (first class) in Electrical Engineering from Universiti Kuala Lumpur-British Malaysian Institute, Malaysia in 2012. From 2018–2020, she worked as a graduate teaching assistant at Brunel University, London. From February 2021 to February 2022, she was a postdoctoral research fellow at the Photonics Research Centre, Universiti Malaya, Malaysia. Currently, she is a lecturer in Power System and a program coordinator for electrical engineering degree course with the Universiti Kuala Lumpur British Malaysian Institute, Malaysia. Her research interests include power system harmonics, power quality, compensation of reactive power and harmonics distortion. Dr. Nor Hidayah is a registered graduate engineer and technologist with Board of Engineers Malaysia (BEM). Also, she is an associate fellow of higher education academy (AFHEA), U.K and a member of IEEE Standards Association.



Shady H. E. Abdel Aleem received the B.Sc., M.Sc. and Ph.D. degrees in Electrical Power and Machines from the Faculty of Engineering, Helwan University, Egypt, in 2002, and the Faculty of Engineering, Cairo University, Egypt, in 2010 and 2013, respectively. Currently, he is an Associate Professor at the Department of Electrical Engineering and Electronics, Valley Higher Institute of Engineering and Technology, Science Valley Academy, Qalubia, Egypt. He is the Vice Dean for Community & Environmental Services. Since September 2019, he is an Adjunct Associate Professor at the Arab Academy for Science, Technology & Maritime Transport, College of Engineering and Technology, Smart Village Campus for teaching power quality energy efficiency, wind energy, and energy conversion courses. Also, he is a consultant of power quality studies in ETA Electric Company, Egypt. His research interests include harmonic problems in power systems, power quality, renewable energy, smart grid, energy efficiency, optimization, green energy, and economics. Dr. Shady is the author or co-author of many refereed journals and conference papers. He has published 180 plus journal and conference papers, 18 plus book chapters, and 10 edited books with the Institution of Engineering and Technology (IET) (2), Elsevier (3), Springer (2), CRC Taylor & Francis (1), and InTech (2). He was awarded the State Encouragement Award in Engineering Sciences in 2017 from Egypt. He was also awarded the medal of distinction from the first class of the Egyptian State Award in 2020 from Egypt. Dr. Shady is a senior member of the Institute of Electrical and Electronics Engineers (IEEE). Dr. Shady is also a member of the Institution of Engineering and Technology (IET). He is an Editor/Guest Editor/Associate Editor for the International Journal of Renewable Energy Technology, Vehicle Dynamics, IET Journal of Engineering, Energies, Sustainability, Technology and Economics of Smart Grids and Sustainable Energy, and others.



Ahmed Faheem Zobaa (M'02–SM'04) received the B.Sc. (Hons), M.Sc., and Ph.D. degrees in electrical power and machines from Cairo University, Giza, Egypt, in 1992, 1997, and 2002, respectively. From 2007 to 2010, he was a Senior Lecturer in Renewable Energy at the University of Exeter, Exeter, U.K. He was also an Instructor from 1992 to 1997, a Teaching Assistant from 1997 to 2002, an Assistant Professor from 2003 to 2008, and an Associate Professor from 2008 to 2013 at Cairo University. Since December 2013, he has been a Professor (on leave) with Cairo University. Currently, he is a Senior Lecturer in Power Systems, an M.Sc. Course Director, and a Full Member with the Institute of Energy Futures, Brunel University London, Middlesex, U.K. His research interests include power quality, (marine) renewable energy, smart grids, energy efficiency, and lighting applications. Dr. Zobaa is an Editor-in-Chief of the *International Journal of Renewable Energy Technology*, and *Technology and Economics of Smart Grids and Sustainable Energy*. He is also an Editorial Board Member, Editor, Associate Editor, and Editorial Advisory Board Member for many international journals. He is a Registered-Chartered Engineer, Chartered Energy Engineer, European Engineer, and International Professional Engineer. He is also a Registered Member of the Engineering Council, U.K.; the Egypt Syndicate of Engineers; and the Egyptian Society of Engineers. He is a Senior Fellow of the Higher Education Academy of U.K. He is a Fellow of the Institution of Engineering and Technology, the Energy Institute of U.K., the Chartered Institution of Building Services Engineers, the Royal Society of Arts, the African Academy of Science, and the Chartered Institute of Educational Assessors. Also, he is a Member of the International Solar Energy Society, the European Power Electronics and Drives Association, the British Institute of Energy Economics, and the IEEE Standards Association.



Bazilah Ismail received the B.Eng. degree in electrical and electronics engineering from The University of Sheffield, U.K., in 2011, and the M.Sc. degree in sustainable electrical power from Brunel University London, U.K., in 2014. She is currently pursuing the Ph.D. degree with Universiti Putra Malaysia (UPM), Malaysia. She is also a Lecturer with the Electrical Engineering Section, Universiti Kuala Lumpur British Malaysian Institute, Malaysia. Her main area of research interests includes reactive power management and optimization in power system, modeling and analyzing FACTS devices, distributed generation, and microgrid in smart grid systems and power electronic applications.



Rania A. Turky received the B.Sc. and M.Sc. degrees in electrical power engineering from the Faculty of Engineering, Ain Shams University, Cairo, Egypt, in 2004 and 2010, respectively, where she is currently pursuing the Ph.D. degree. Her research interests include modern control techniques, power systems dynamics and control, energy storage systems, renewable energy systems, and smart grids.